



Cove Cay

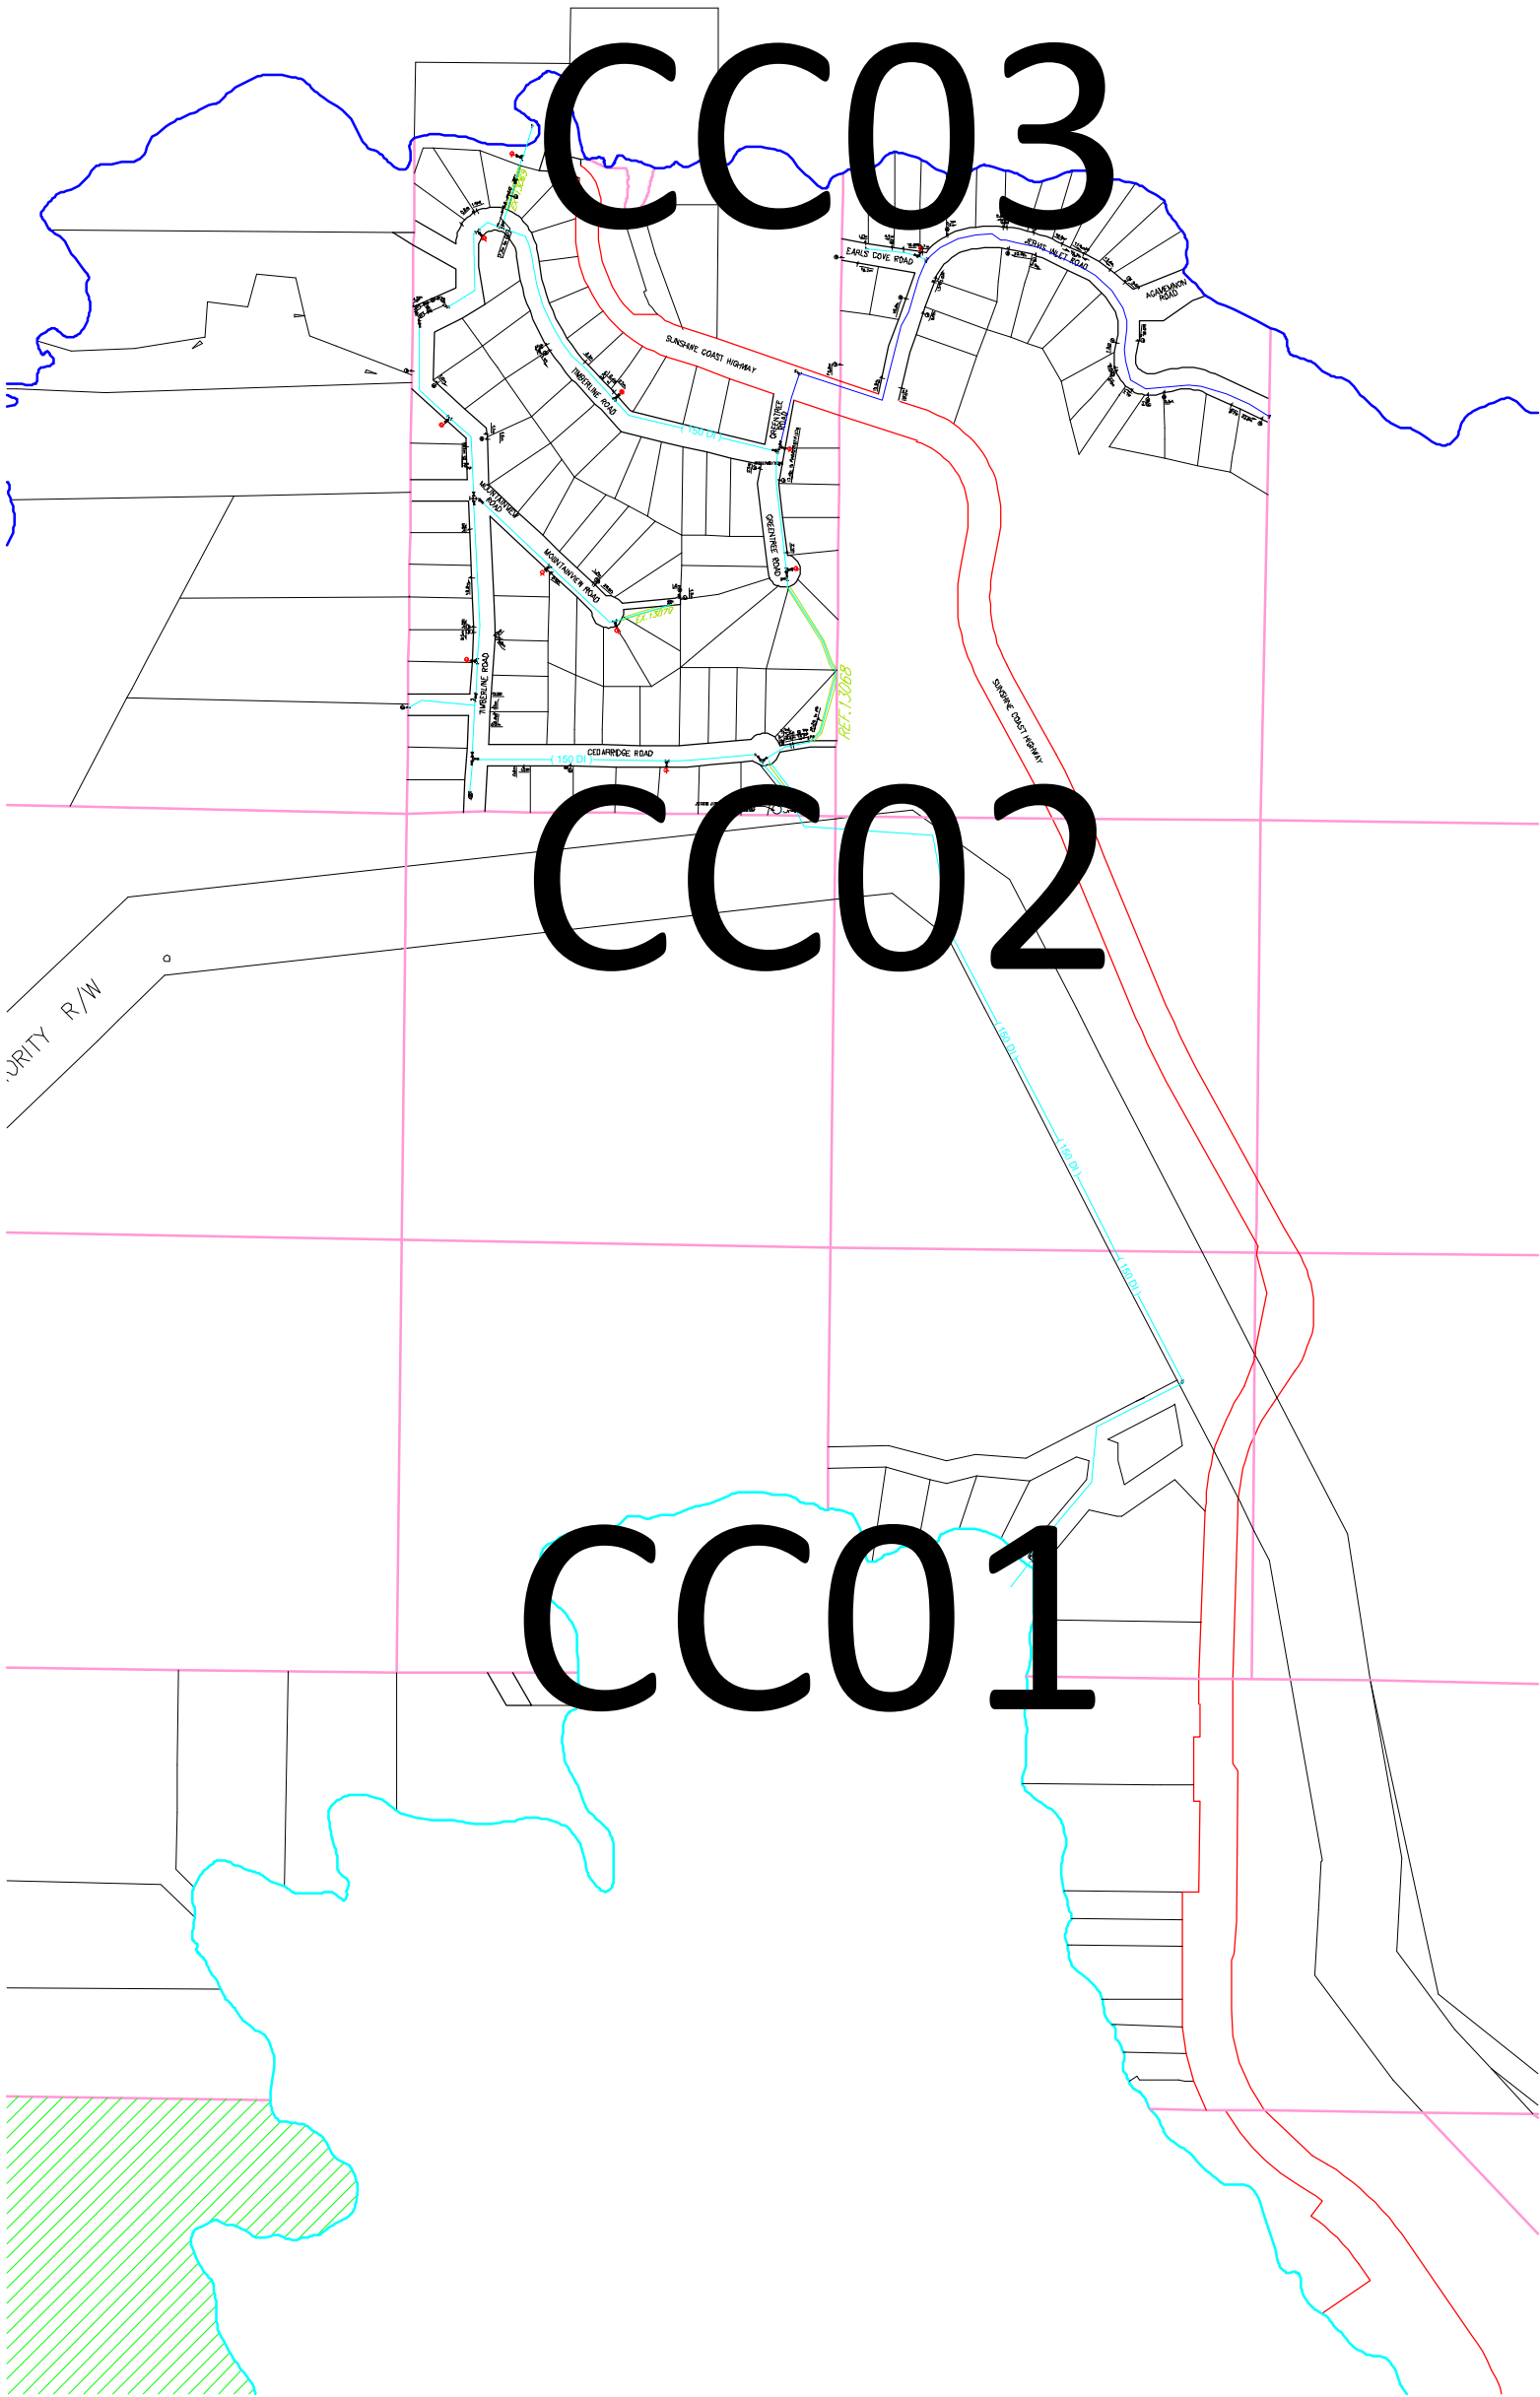

LEGEND


	STEEL Steel
	750mm Ductile Iron
	600mm Ductile Iron
	450mm Ductile Iron
	400mm Ductile Iron
	350mm Ductile Iron
	300mm Welded Steel
	300mm HD Polyethylene
	300mm Ductile Iron
	300mm Asbestos Cement
	250mm HD Polyethylene
	250mm Ductile Iron
	200mm PVC
	200mm Ductile Iron
	200mm Asbestos Cement
	150mm PVC
	150mm Ductile Iron
	150mm Asbestos Cement
	100mm Welded Steel
	100mm PVC
	100mm Ductile Iron
	100mm Asbestos Cement
	75mm PVC
	75mm Copper
	75mm Ductile Iron
	50mm PVC
	50mm Copper
	50mm Galvanized
	38mm PVC
	31mm PVC
	25mm PVC
	25mm Copper
	Abandoned Water Main
	Air Relief Valve
	Blow Off Valve
	Check Valve
	Gate Valve
	Pressure Reducing Valve
	Cap
	Cross
	Elbows
	Tees
	Reducer
	Connection
	Meter
	Offset
	Connection at Property Pin
	Yoke
	Fire Hydrant
	Standpipe
	Pump Station
	Power Pole
	Man Hole

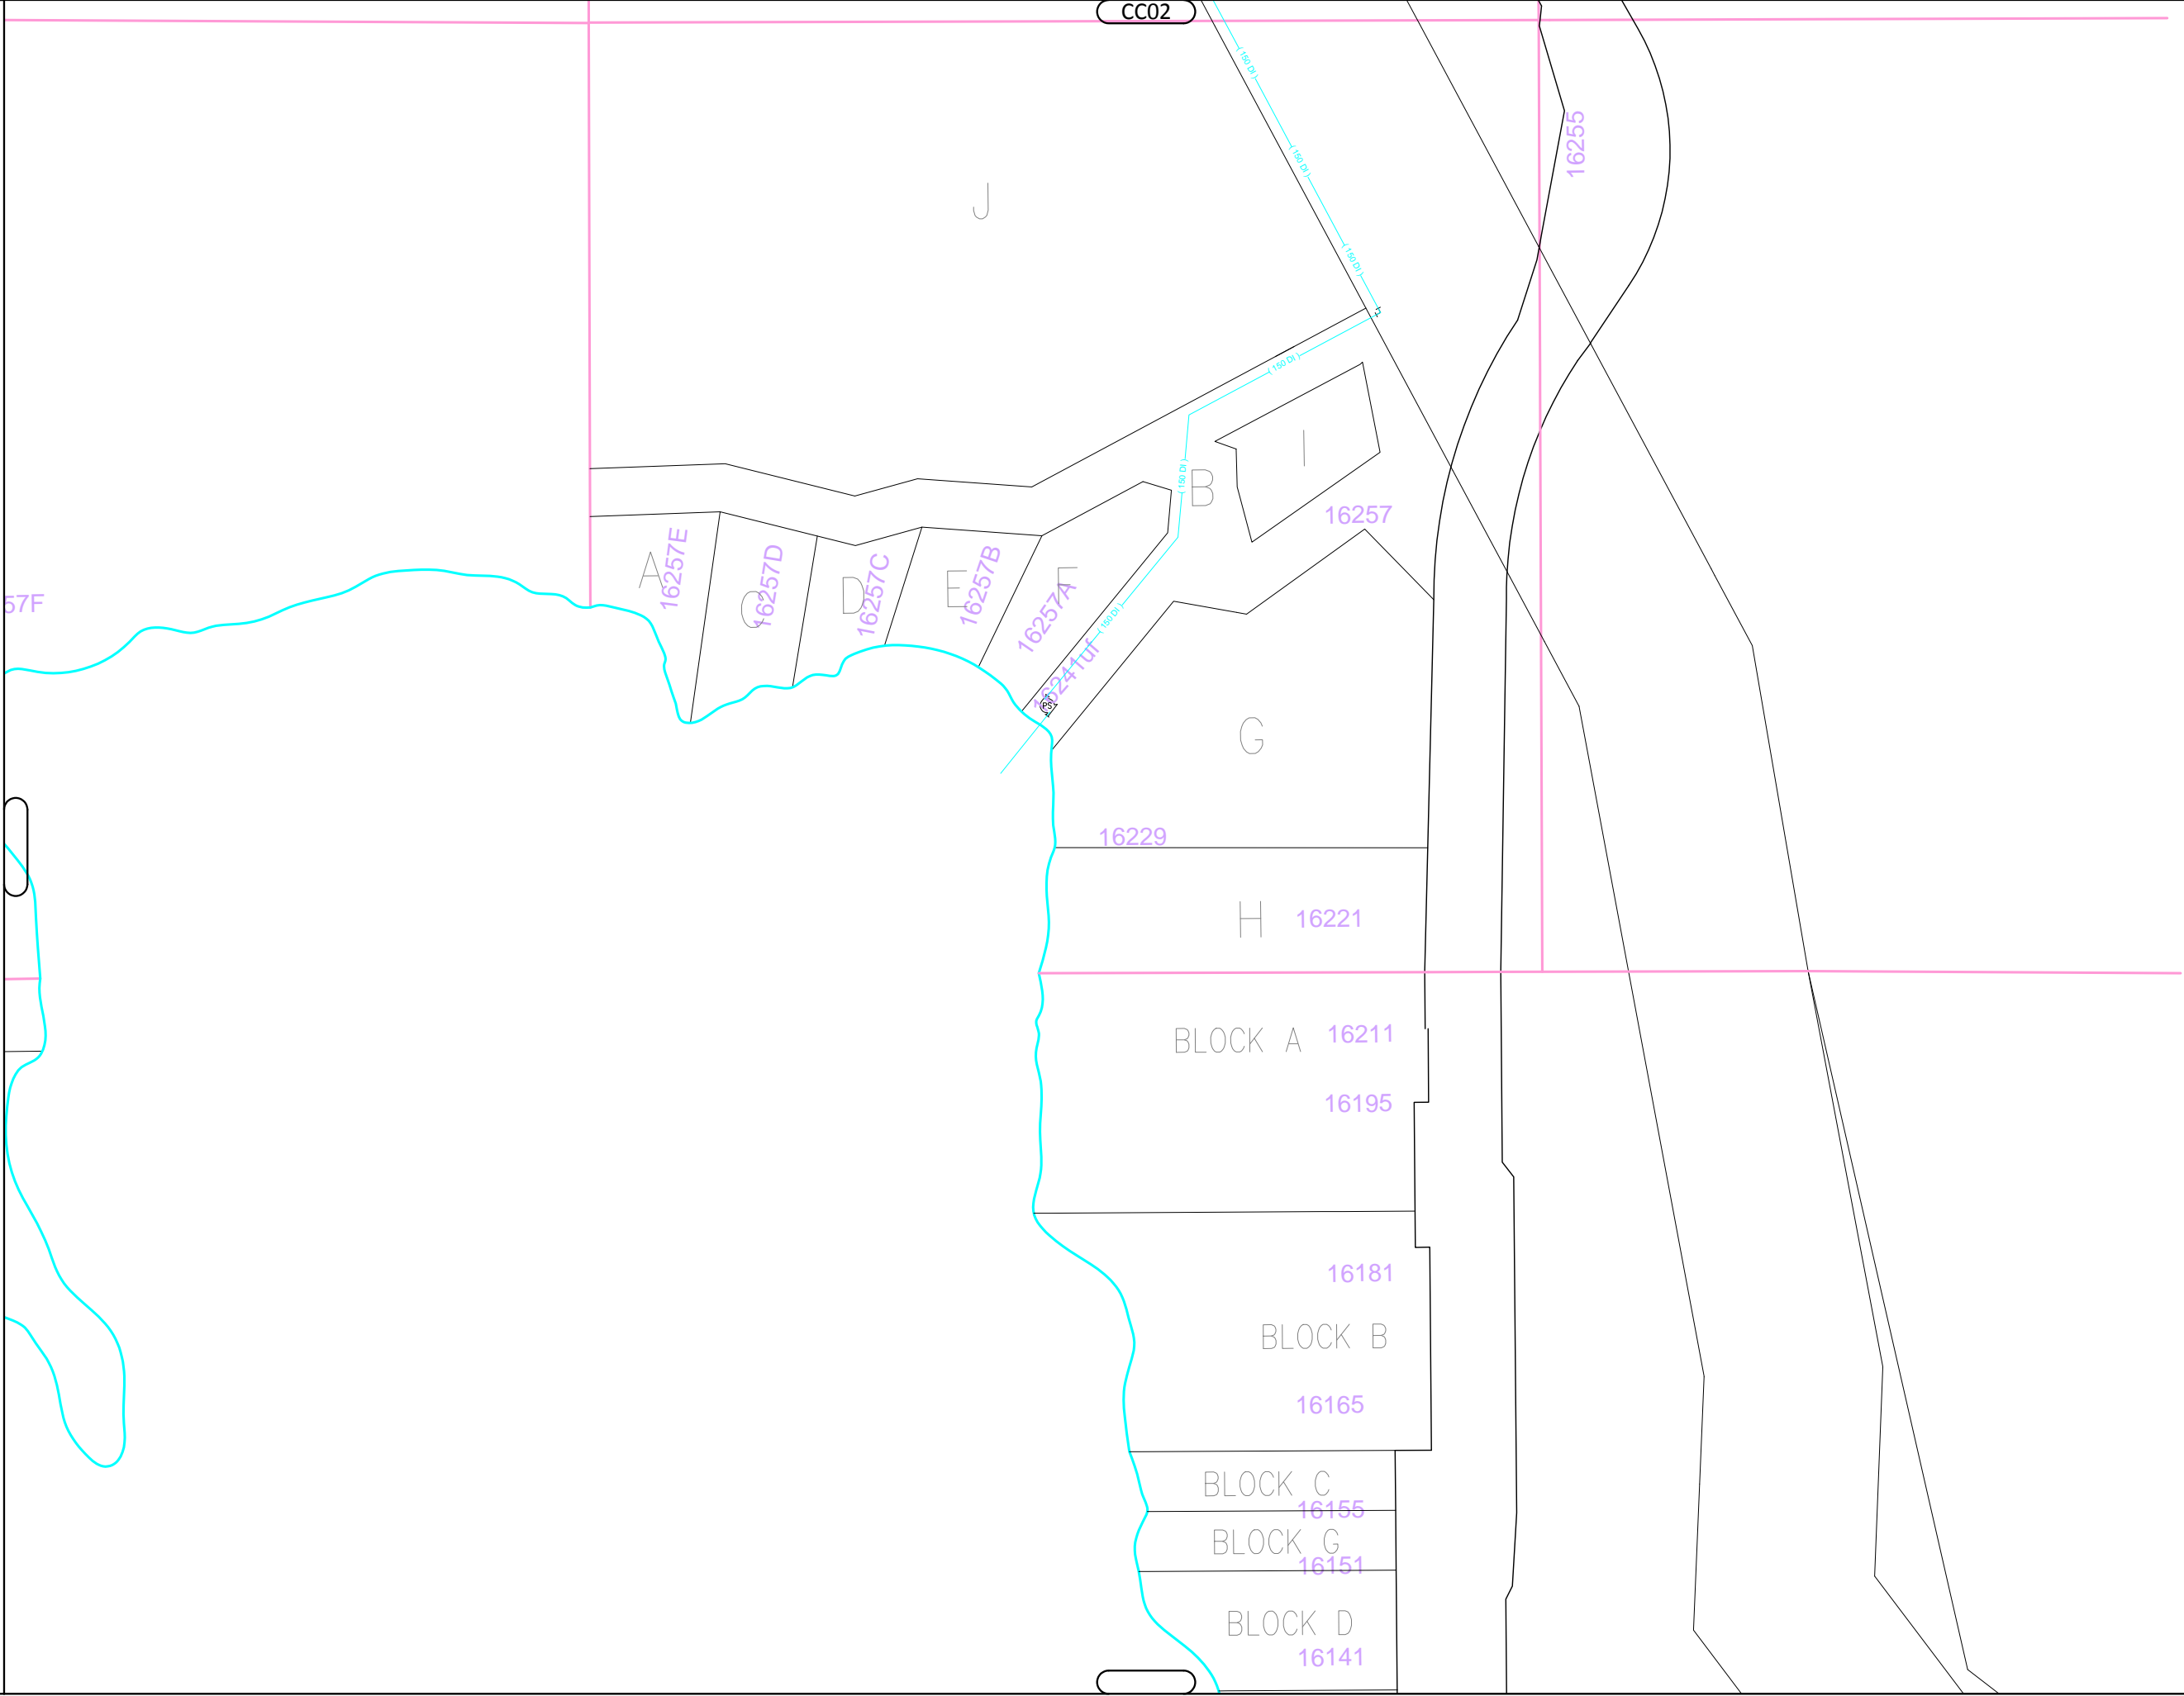

INFRASTRUCTURE SERVICES
SUNSHINE COAST REGIONAL DISTRICT

This information
number of sour
responsibility fo

This information has been compiled by the Sunshine Coast Regional District using data derived from a number of sources with varying levels of accuracy. The Sunshine Coast Regional District disclaims all responsibility for the accuracy or completeness of this information.



CC01

LEGEND

- (STEEL)

(750 DI)

(600 DI)

(450 DI)

(400 DI)

(350 DI)

(300 WS)

(300 HDPE)

(300 DI)

(300 AC)

(250 HDPE)

(250 DI)

(200 PVC)

(200 DI)

(200 AC)

(150 PVC)

(150 DI)

(150 AC)

(100 WS)

(100 PVC)

(100 DI)

(100 AC)

(75 PVC)

(75 K)

(75 DI)

(50 PVC)

(50 K)

(50 GALV)

(38 PVC)

(31 PVC)

(25 PVC)

(25 K)

(50 PVC)
- Abandoned Water Main
- Air Relief Valve

Blow Off Valve

Check Valve

Gate Valve

Pressure Reducing Valve

Cap

Cross

Elbows

Tees

Reducer

Connection

Meter

Offset

Connection at Property Pin

Yoke


Fire Hydrant

Standpipe

Pump Station

Power Pole

Man Hole

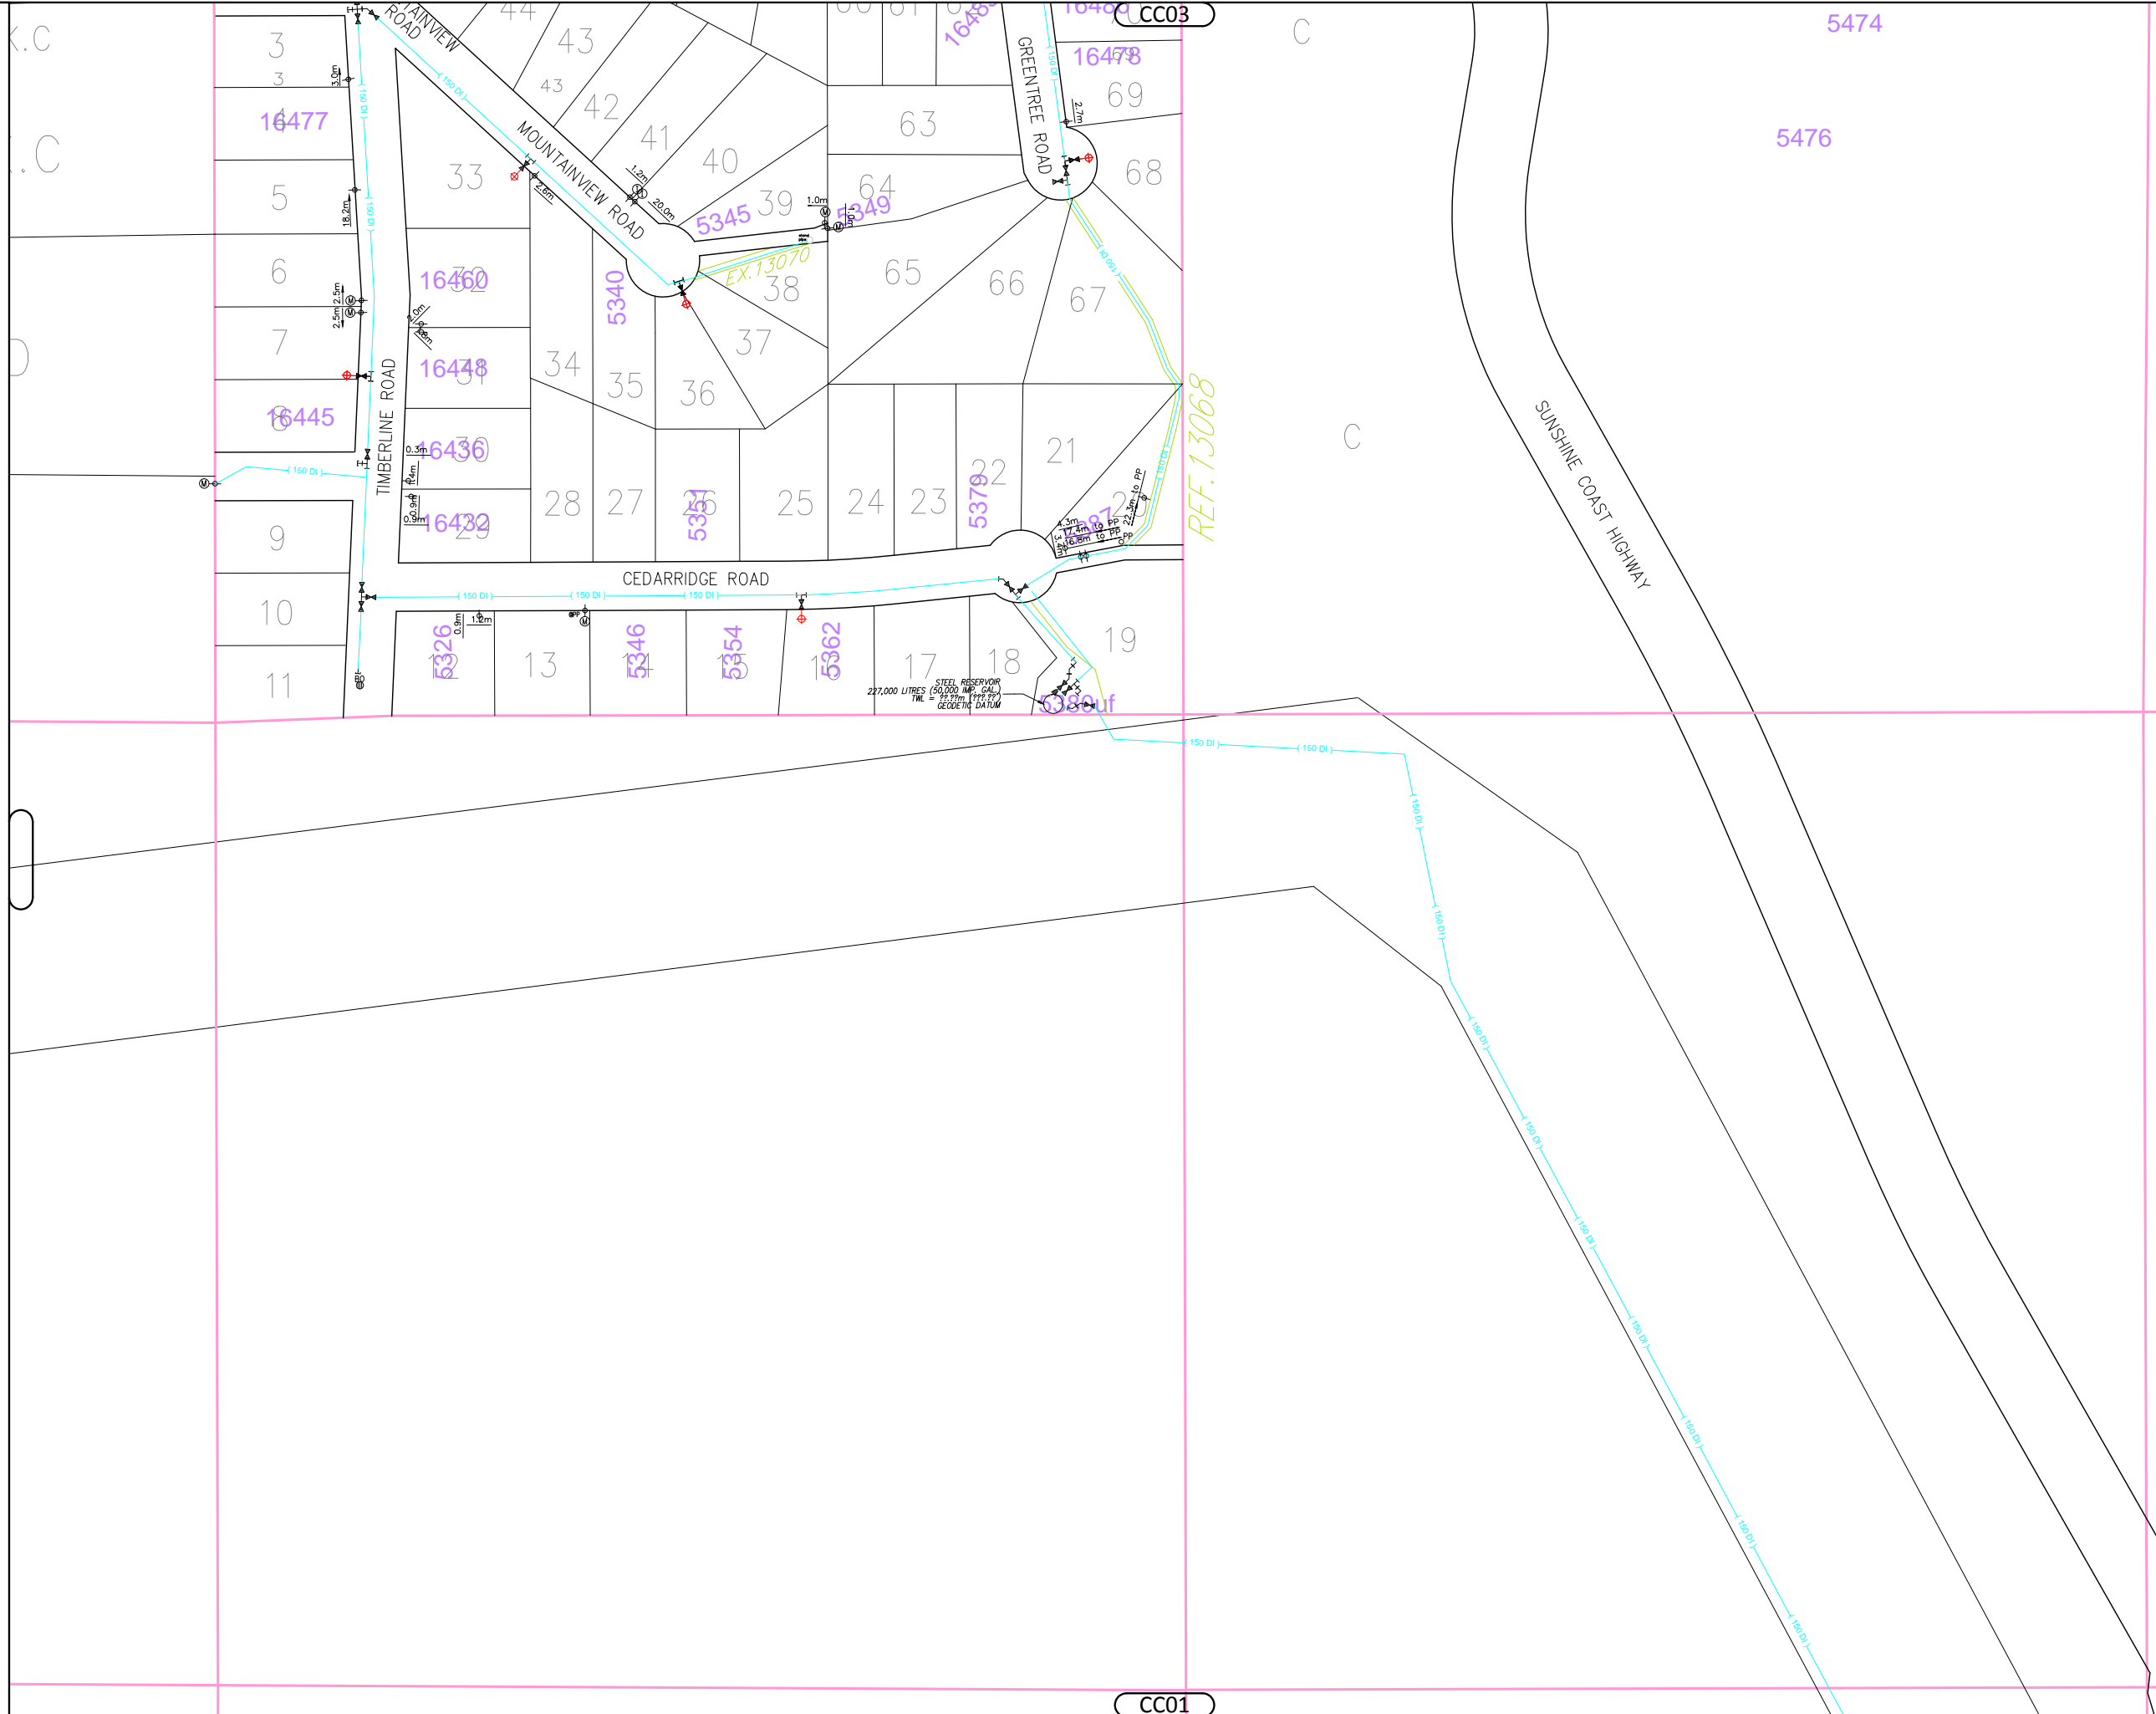

CC03

CC01

CC02



This information has been compiled by the Sunshine Coast Regional District using data derived from a number of sources with varying levels of accuracy. The Sunshine Coast Regional District disclaims all responsibility for the accuracy or completeness of this information.

COVE CAY
AREA:
PLOT DATE: December 31, 2014

INFRASTRUCTURE SERVICES
SUNSHINE COAST REGIONAL DISTRICT



LEGEND

- (STEEL)

STEEL Steel
- (750 DI)

750mm Ductile Iron
- (600 DI)

600mm Ductile Iron
- (450 DI)

450mm Ductile Iron
- (400 DI)

400mm Ductile Iron
- (350 DI)

350mm Ductile Iron
- (300 WS)

300mm Welded Steel
- (300 HDPE)

300mm HD Polyethylene
- (300 DI)

300mm Ductile Iron
- (300 AC)

300mm Asbestos Cement
- (250 HDPE)

250mm HD Polyethylene
- (250 DI)

250mm Ductile Iron
- (200 PVC)

200mm PVC
- (200 DI)

200mm Ductile Iron
- (200 AC)

200mm Asbestos Cement
- (150 PVC)

150mm PVC
- (150 DI)

150mm Ductile Iron
- (150 AC)

150mm Asbestos Cement
- (100 WS)

100mm Welded Steel
- (100 PVC)

100mm PVC
- (100 DI)

100mm Ductile Iron
- (100 AC)

100mm Asbestos Cement
- (75 PVC)

75mm PVC
- (75 K)

75mm Copper
- (75 DI)

75mm Ductile Iron
- (50 PVC)

50mm PVC
- (50 K)

50mm Copper
- (50 GALV)

50mm Galvanized
- (38 PVC)


38mm PVC
- (31 PVC)

31mm PVC
- (25 PVC)

25mm PVC
- (25 K)

25mm Copper
- (50 PVC)

Abandoned Water Main
- Air Relief Valve
- Blow Off Valve
- Check Valve
- Gate Valve
- Pressure Reducing Valve
- Cap
- Cross
- Elbows
- Tees
- Reducer
- Connection
- Meter
- Offset
- Connection at Property Pin
- Yoke
- Fire Hydrant
- Standpipe
- Pump Station
- Power Pole
- Man Hole

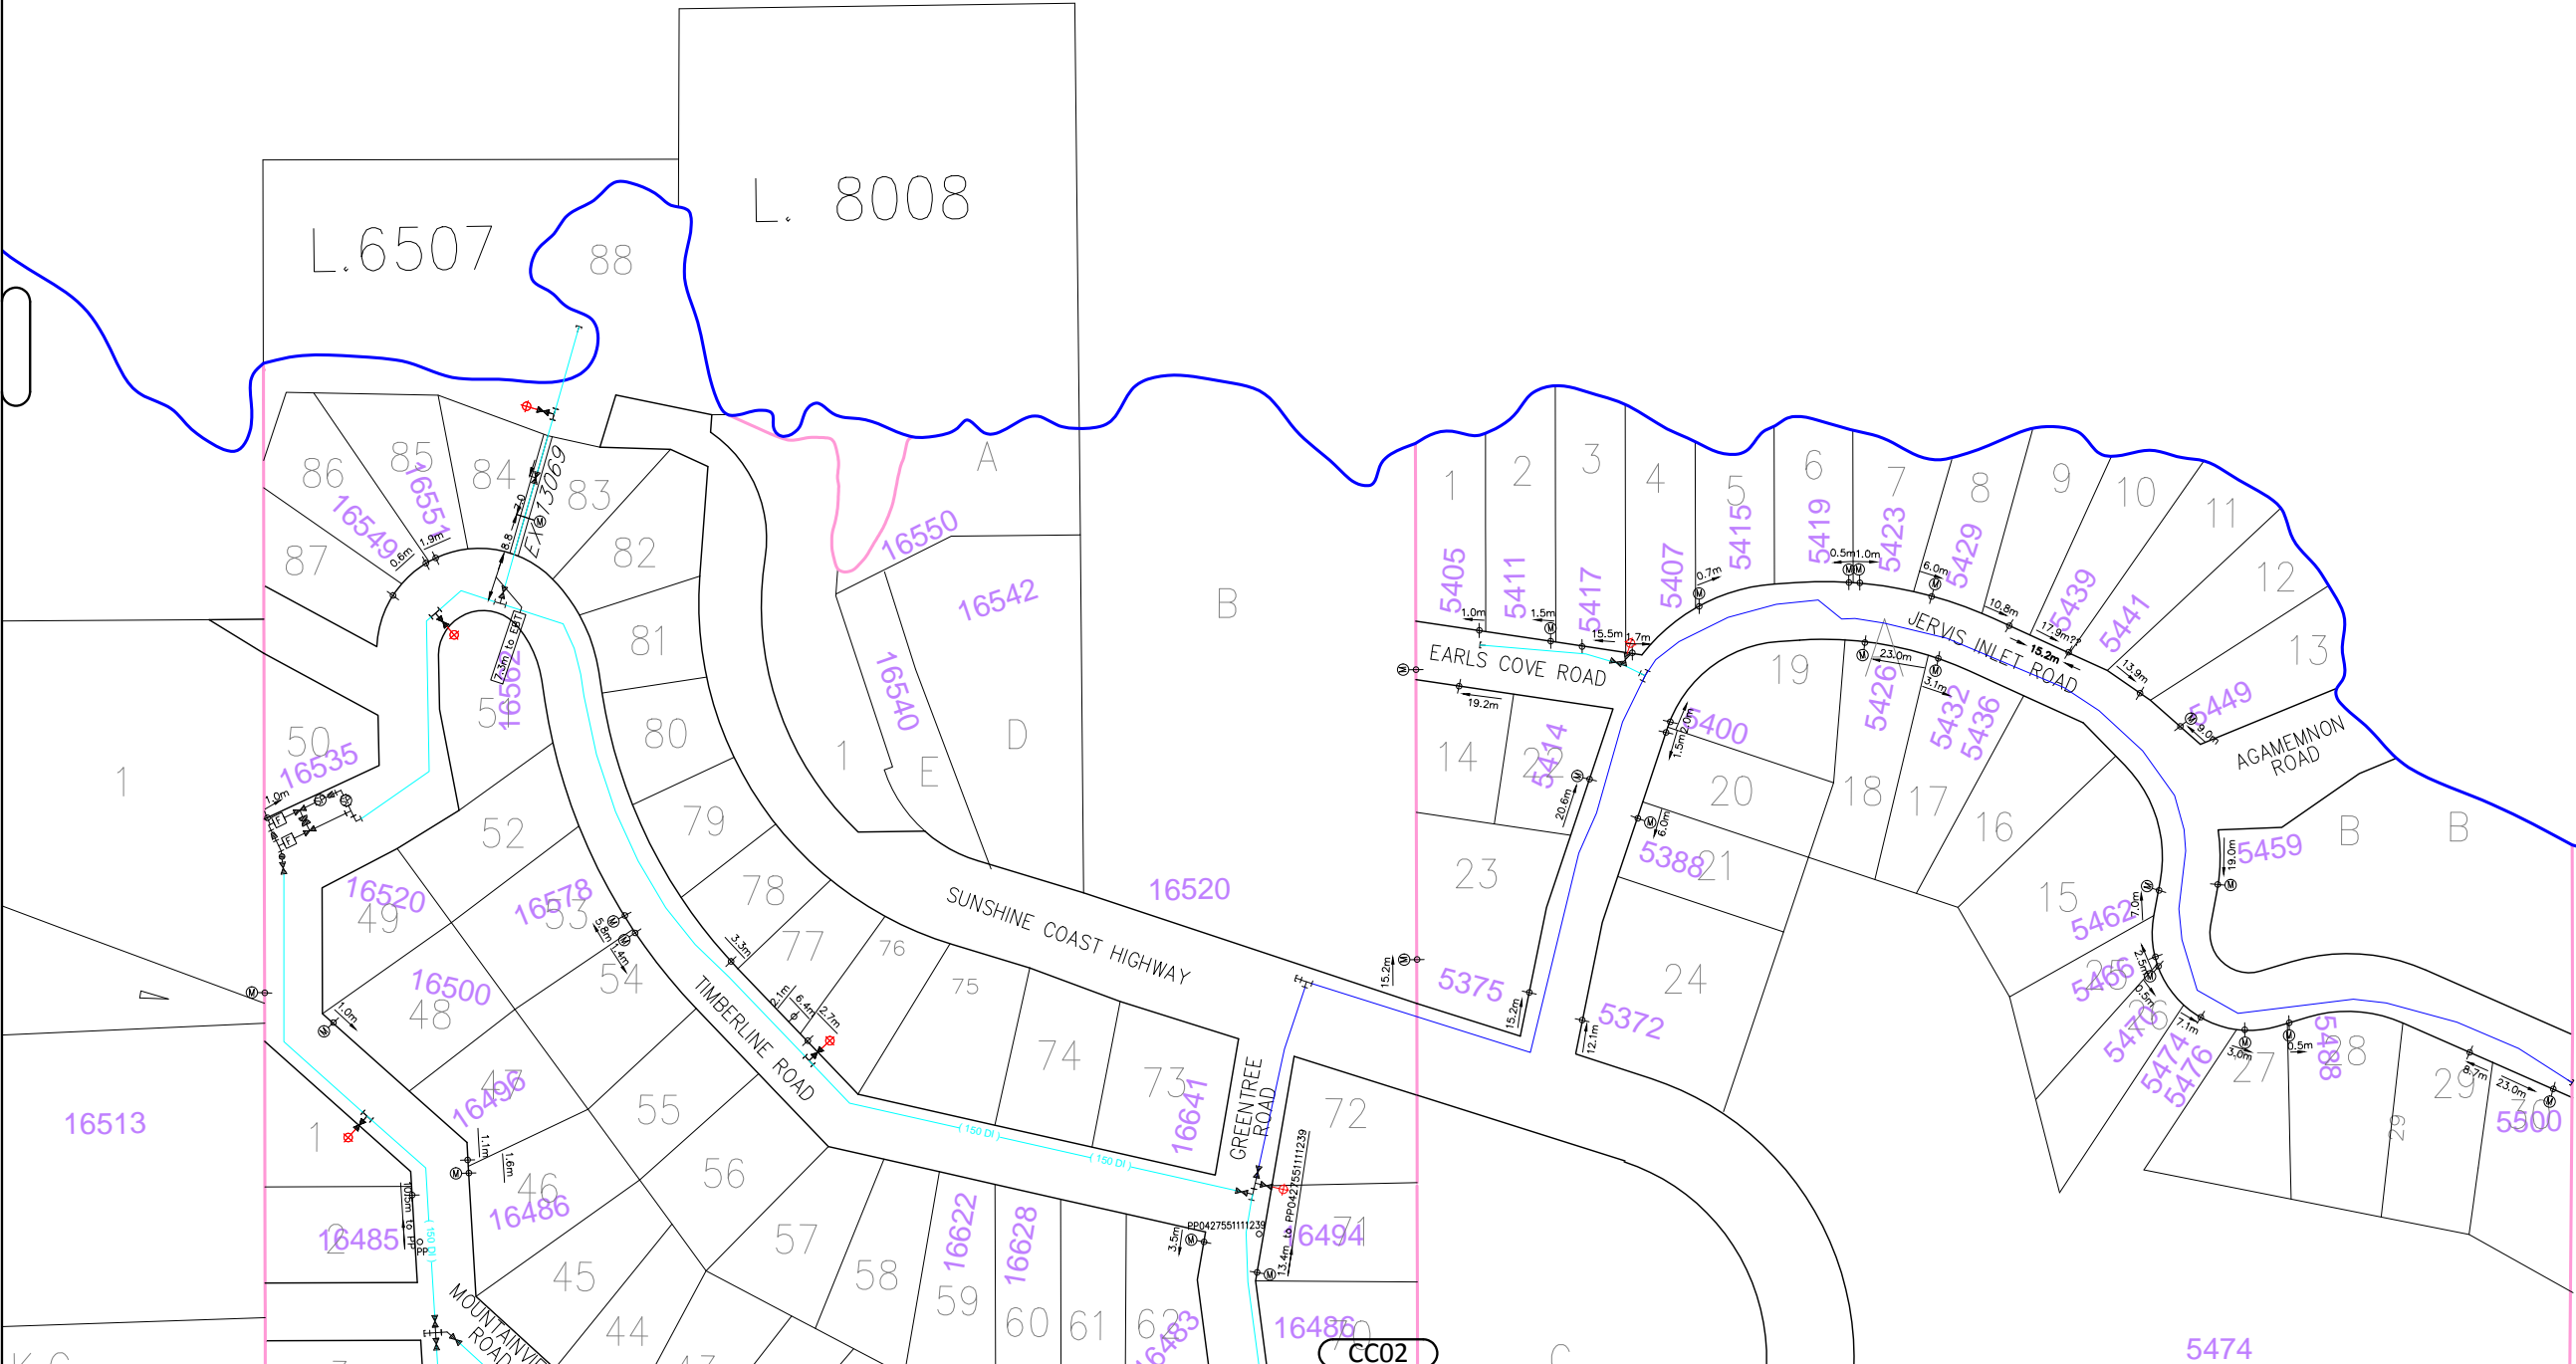

This information has been compiled by the Sunshine Coast Regional District using data derived from a number of sources with varying levels of accuracy. The Sunshine Coast Regional District disclaims all responsibility for the accuracy or completeness of this information.

AREA: COVE CAY
PLOT DATE: December 31, 2014

INFRASTRUCTURE SERVICES
SUNSHINE COAST REGIONAL DISTRICT



CC03